



ETA-Danmark A/S
Göteborg Plads 1
DK-2150 Nordhavn
Tel. +45 72 24 59 00
Fax +45 72 24 59 04
Internet www.etadanmark.dk

Authorised and notified according
to Article 29 of the Regulation (EU)
No 305/2011 of the European
Parliament and of the Council of 9
March 2011

MEMBER OF EOTA



European Technical Assessment ETA-24/0910 of 2026/03/11

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011:ETA-Danmark A/S

Trade name of the construction product:

Rockpanel A2, 8 mm finish Colours,
Rockpanel A2, 8 mm finish Ply and
Rockpanel A2, 8 mm finish ProtectPlus

Product family to which the above construction product belongs:

Prefabricated mineral wool boards with organic or inorganic finish and with specified fastening system

Manufacturer:

ROCKWOOL B.V.
Konstruktieweg 2
NL-6045 JD Roermond
Tel. +31 475 353 000
Fax +31 475 353 550

Manufacturing plant:

ROCKWOOL B.V. / Rockpanel
Konstruktieweg 2
NL-6045 JD Roermond

This European Technical Assessment contains:

31 pages including 5 annexes which form an integral part of the document

This European Technical Assessment is issued in accordance with Article 95(4) of Regulation (EU) 2024/3110, on the basis of:

European Assessment Document (EAD) no. EAD 090001-00-0404 for Prefabricated compressed mineral wool boards with organic or inorganic finish and with specified fastening system

This version replaces:

The previous ETA with the same number issues on 2025-01-28

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

1. Technical description of product

General

Rockpanel A2, 8 mm finish Colours, Rockpanel A2, 8 mm finish Ply and Rockpanel A2, 8 mm finish ProtectPlus are prefabricated compressed mineral wool panels with thermo-hardening synthetic binders. The boards are fastened to timber, aluminium or steel subframes. Fastening to the timber subframe is carried out with corrosion resistant nails, screws or by bonding (with an intermediate Rockpanel strip with specified finish). Fastening to the aluminium or steel subframe is carried out with corrosion resistant rivets, self-drilling screws or by bonding.

Mechanical fasteners, gaskets, adhesives with primers, strips for bonding, aluminium and steel profiles are specified by the ETA-holder.

The physical properties of the panels are indicated in Table 1.

Table 1:

| Property | Value |
|------------------------------------|-----------------------------------|
| Thickness, nominal | 8 mm |
| Length, max | 3050 mm |
| Width, max | 1250 mm |
| Density, nominal | 1170 kg/m ³ |
| Bending strength, length and width | $f_{05} \geq 27 \text{ N/mm}^2$ |
| Modulus of elasticity | $m(E) \geq 4015 \text{ N/mm}^2$ |
| Thermal conductivity EN 10456 | 0.47 W/(m*K) |
| Cumulative dimensional change % | Length: 0.072 % Width: 0.072 % |

Finishes

The finishes are indicated in Table 2. The coatings are provided in a number of colours.

The Rockpanel A2, 8 mm Colours panels are surface treated on one side with water-borne primer- and water-borne coloured paint layers, in a range of colours.

The Rockpanel A2, 8 mm Ply panels are surface treated on one side with water-borne primer layers, in a white colour.

The Rockpanel A2, 8 mm ProtectPlus panels are surface treated on one side with water-borne primer and a water-borne coloured paint, which has been provided with an extra anti-graffiti clear coat on top of the colour paint. The finishes “Woods”, “Stones” and “Chameleon” contain an (additional) design layer on

top of the coloured paint. In the event of “Textured” the front side of the board has a slightly textured surface with depths between the product tolerances of +/- 0,5 mm.

Table 2:

| | |
|---|--|
| Rockpanel A2 Colours (water-borne polymer emulsion paint) | Colour coating in a range of colours |
| Rockpanel A2 Ply (water-borne primer layer) | Coloured primer RAL 9010 |
| Rockpanel A2 ProtectPlus (water-borne polymer emulsion paint with anti-graffiti clear coat) | Clear coat pure or Clear coat with wood design “Woods” e.g. Teak, Alder etc. or Clear coat with stone design “Stones” e.g. Mineral Chalk, Basalt Anthracite etc. or with metallic particles “Metals” e.g. Aluminium, Brass etc. and clear coat with design “Chameleon” or Clear coat with design “Textured” e.g. Carrara White, Sapphire Blue etc. |

The colour fastness of the panels is indicated in Table 3.

Table 3:

| Colour fastness after 5000 hours artificial weathering (TR010 climate class S) | |
|--|-------------------------|
| finish | Value (ISO 105 A02) |
| finish Colours: | 3-4 or better |
| finish Ply: | No Performance assessed |
| finish ProtectPlus: | 4 or better |

Fasteners

The panels are mechanically fixed to vertical timber, aluminium or steel, or bonded to timber (with intermediate mechanically fastened Rockpanel strips with specified finish) or aluminium.

The mechanical fastening to timber battens is carried out with Rockpanel stainless steel screws 4.5 x 35 mm no. 1.4401 or 1.4578 (EN 10088) with heads in the colour of the panels or Rockpanel High Performance nails: 2.7/3.1 x 35 mm, stainless steel quality no. 1.4401 or 1.4578 (EN 10088) with heads in the colour of the panels.

Fastening to aluminium is carried out with EN AW-5019 (AlMg5) rivets, head diameter 14 mm, body diameter 5 mm, head colour coated or with an austenitic stainless steel self-drilling screw (A4 in accordance with EN ISO 3506), head diameter 15 mm, body diameter 5.8 mm, head colour coated.

Fastening to the steel subframe is carried out with either EN 10088 (no. 1.4578) rivets, head diameter 15 mm, body diameter 5 mm, head colour coated, or EN 10088 (no. 1.4567) rivets, head diameter 14 mm, body diameter 5 mm, head colour coated or a stainless steel EN 10088 (no. 1.4404) self-drilling screw, head diameter 12 mm, body diameter 4.3 mm, head colour coated. The screw is available in 5.5 x 25 for a clamping thickness up to 9 mm, or 5.5 x 35 mm for a clamping thickness up to 19 mm.

For correct fixing, a riveting tool with rivet spacer must be used, see Table 5 and Table 7 of the ETA.

Bonding to both timber framing (with intermediate mechanically fastened Rockpanel strips with specified finish) and aluminium rails is carried out with Bostik S970 Paneltack S adhesive. The bonding shall be carried out in accordance with the manufacturer's instructions. See Annex 1. Bonding is only allowed on vertical sub-constructions with a drained cavity for ventilated applications.

The maximum fixing distances and hole diameter are shown in Tables 8 and 9 of the ETA.

The installation method with the use of fixed points and moving points is shown in Annex 3, Table 8 and Figure 2 of the ETA.

The design value of the axial load is shown in Table 7 and Table 10 to 10-5 of the ETA.

2. Specification of the intended use in accordance with the applicable European Assessment Document (hereinafter EAD)

The boards are intended for external cladding and for fascia's and soffits. The cladding on vertical timber battens with mechanically fixed boards can be carried out with or without ventilated cavities at the back. The cladding applied with the bonding system on vertical timber battens, provided with mechanically fixed Rockpanel strips (with specified finish), must be carried out with a ventilated cavity at the back. The cladding on a vertical aluminium or steel subframe shall be carried out with ventilated cavities at the back. See Annex 1.

Subframes

The panels are mechanically fixed to vertical timber, aluminium or steel, or bonded to timber (with intermediate mechanically fastened Rockpanel strips with specified finish) or aluminium.

The minimum thickness of the vertical aluminium profiles is 1.5 mm (rivets) or 1.8 mm (self-drilling screws). The aluminium quality is minimal AW-6060 according to EN 755-2. The $R_m/R_{p0.2}$ value is $\geq 170/140$ for profile T6 and $\geq 195/150$ for profile T66.

The minimum thickness of the vertical steel profiles is either 1.0 mm [a] (steel quality is minimal S280GD +Z EN 10346 number 1.0250, or equivalent for cold forming), or 1.5 mm [a] (steel quality EN 10025-2:2004 S235JR number 1.0038).

[a] *The minimum coating thickness (Z or ZA) is determined by the corrosion rate (amount of corrosion loss in thickness per year) which depends on the specific outdoor atmospheric environment. The International Zinc association can be consulted for more information. The coating designation (classification which determines the coating mass) shall be agreed between the contractor and the building owner. Alternatively, a hot dip galvanized coating according to EN ISO 1461 can be used.*

The vertical timber battens should have a minimum thickness of 25 mm (solid wood). Also LVL battens (Laminated Veneer Lumber) with a minimum thickness of 27 mm, according to EN 14374, can be used (Ultralam R, CE 0672-CPD-I).

Appropriate preservative treatment of subframes

Use the appropriate part of EN 335 to identify the "use class" of a given service environment and geographical location. Table 1 in EN 335 will assist in determining the biological agents that can attack timber in certain situations. The user can then consider the type and duration of performance required select an appropriate level of durability and ensure that the timber or wood-based product specified has either, as a natural (see EN 350-2) or an acquired characteristic

durability as the result of appropriate preservative treatment (see EN 351-1).

In the event vertical profiles cannot be applied, horizontal profiles can be used carried out with ventilated cavities e.g. by a double crossed sub-construction.

Joints

Horizontal joints on metal sub-constructions

The horizontal joints between the panels can be open in case of steel supports or aluminium rail supports.

Horizontal joints on timber sub-constructions

In case of open horizontal joints an EPDM gasket must be applied on the vertical battens with a width 15 mm at both sides wider than the batten.

In case of closed joints for panels mechanically fixed on timber battens, a Rockpanel "A" extruded aluminium chair profile or equivalent can be used to close the joints. The chair profile has an overlap of at least 15 mm on the board above the profile. (See Annex 1, Figure 1a). In case of a closed joint an EPDM gasket is fixed to the timber battens. For a non-ventilated application, a 3 mm thick EPDM foam gasket with self-adhering backside is obliged.

The provisions made in this European Technical Assessment are based on an assumed intended working life of the kit of 50 years.

In addition, for aluminium support systems intended to be used for facades: In some member states national climate conditions may reduce the service life of the aluminium support system to 35 years or more.

An additional assessment of the aluminium support system might be necessary to comply with Member State regulations or administrative provisions.

The indications given regarding the working life cannot be interpreted as a guarantee from the manufacturer nor by the Assessment Body, but are regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

Characteristic

Assessment of characteristic

3.2 Safety in case of fire (BWR 2)

Reaction to fire

Classification of panels: See Table 4

Adhesive: No performance assessed

3.3 Hygiene, health and the environment (BWR 3)

Dangerous substances

The kit does not contain/release dangerous substances except:
Formaldehyde concentration 0.0105 mg/m³ Formaldehyde class E1*

The used fibres are not potential carcinogenic

No biocides are used in the Rockpanel boards

No flame retardant is used in the boards

No cadmium is used in the boards.

Water vapour permeability

A2, 8 mm Colours: $S_d < 1.7$ m at 23°C and 85 %RH

A2, 8 mm Ply: **No performance assessed**

A2, 8 mm ProtectPlus: $S_d < 3.2$ m at 23°C and 85 %RH

The designer shall consider the relevant needs for ventilation, heating and insulation to minimise condensation in service.

Water permeability incl. joints for non-ventilated applications

No Performance Assessed

Drainability

No Performance Assessed

*) In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.4 Safety and accessibility in use (BWR 4)

The following concerns performances for mechanical resistance including pull-out and pull-through resistance of fasteners, wind suction and wind pressure resistance and shear resistance of fasteners and mechanical resistance of boards.

In absence of national regulations the design values X_d may be calculated as indicated in the ETA (see Table 10 to 10-5). Below the safety factors are listed which have been used in the calculation of the design values.

Design values of axial loads

The design value X_d is obtained by dividing the characteristic value X_k by a partial factor γ_M : $X_d = X_k / \gamma_M$

The design value X_d of a material property can be expressed in general terms as $X_d = \eta * X_k / \gamma_m$.

For Rockpanel $\gamma_m = 1.6$. The conversion factor $\eta = 0.8$ [aged bending strength divided by the f_{05}].

As a result $\gamma_M = 2.0$

Design values are given for information – national factors have to be taken into account in final design

| Aluminium subframe | Rivet | Self-drilling screw |
|--|-------------------------------------|-------------------------------------|
| | Annex 3 Table 10 | Annex 3 Table 10-1 |
| Design value of axial loads | 481 / 324 / 193 N | 493 / 297 / 152 N |
| Characteristic shear strength | Failure load: 2718 N | Failure load: 2347 N |
| Average values | Deformation: 3.3 mm | Deformation: 4.0 mm |
| Wind load resistance | Middle / Edge / Corner | Middle / Edge / Corner |
| - Average strength [N] | 1645 / 791 / 387 N | 1486 / 746 / 303 N |
| - Average failure load [N/m ²] | 3025 / 3350 / 3507 N/m ² | 2732 / 3159 / 2748 N/m ² |
| - Maximum deformations [mm] | 29 / 31 / 30 mm | 24 / 26 / 27 mm |

| Characteristic | Assessment of characteristic | | |
|--|--|---|--|
| Steel subframe | Rivet | Self-drilling screw | |
| | Annex 3 Table 10-2 | Annex 3 Table 10-3 | |
| | Design value of axial loads | 463 / 340 / 221 N | 416 / 333 / 225 N |
| | Characteristic shear strength Average values | Failure load: 2913 N Deformation: 2.9 mm | Failure load: 2293 N Deformation: 2.2 mm |
| | Wind load resistance - Average strength [N] - Average failure load [N/m ²] - Maximum deformations [mm] | Middle / Edge / Corner 1455 / 1162 / 675 N 2676 / 4916 / 6122 N/m ² 21 / 42 / 40 mm | Middle / Edge / Corner 1568 / 978 / 537 N 2883 / 4140 / 4872 N/m ² 33 / 36 / 34 mm |
| Timber subframe | High Performance nail | Torx screw | |
| | Annex 3 Table 10-4 | Annex 3 Table 10-5 | |
| | Design value of axial loads | Design value X_d depends on the modification factor k_{mod} , the strength class of the wood and the different materials factors γ_M . | |
| | Characteristic shear strength Average values | Failure load: 1423 N Deformation: 7.5 mm | Failure load: 2254 N Deformation: 7.1 mm |
| | Wind load resistance - Average strength [N] - Average failure load [N/m ²] - Maximum deformations [mm] | Middle / Edge / Corner 973 / 595 / 322 N 2661 / 3777 / 4084 N/m ² 8 / 38 / 34 mm | Middle / Edge / Corner 1337 / 560 / 296 N 2438 / 2332 / 2645 N/m ² 10 / 23 / 24 mm |
| Bostik S970 Paneltack S adhesive | | | |
| | Conditions | Contact surface: rear of the board onto: | |
| Initial tensile strength adhesive characteristic and design [a] [b] | +23°C, -20°C, -40°C and +80°C | ProtectPlus: $X_k = 9.45 \text{ N/mm}^1$; $X_d = 2.36 \text{ N/mm}^1$ Colours: $X_k = 10.75 \text{ N/mm}^1$; $X_d = 2.69 \text{ N/mm}^1$ Aluminium: $X_k = 7.80 \text{ N/mm}^1$; $X_d = 1.95 \text{ N/mm}^1$ | |
| Initial tensile strength FoamTape characteristic and design [b] | +23°C | ProtectPlus: $X_k = X_d = 2.03 \text{ N/mm}^1$ Colours: $X_k = X_d = 2.14 \text{ N/mm}^1$ Aluminium: $X_k = X_d = 2.93 \text{ N/mm}^1$ | |
| Shear strength under permanent load ($X_d = \Gamma_\infty$) adhesive characteristic and design [b] [c] | +23°C, -20°C, -40°C and +80°C | ProtectPlus: $X_k = 2.49 \text{ N/mm}^1$; $X_d = 0.062 \text{ N/mm}^1$ Colours: $X_k = 2.49 \text{ N/mm}^1$; $X_d = 0.062 \text{ N/mm}^1$ Aluminium: $X_k = 1.99 \text{ N/mm}^1$; $X_d = 0.050 \text{ N/mm}^1$ | |
| Initial shear strength FoamTape characteristic and design [b] [d] | +23°C | ProtectPlus: $X_k = X_d = 1.17 \text{ N/mm}^1$ Colours: $X_k = X_d = 1.17 \text{ N/mm}^1$ Aluminium: $X_k = X_d = 0.75 \text{ N/mm}^1$ | |
| Deformation shear declared for the Bostik S970 Paneltack S adhesive | +23°C, -20°C, -40°C and +80°C | ProtectPlus: 348% to 871% Colours: 348% to 871% Aluminium: 331% to 718% | |
| Impact resistance | Panels without a horizontal joint: Rockpanel A2, 8 mm finish Colours, Ply or ProtectPlus: classified category III according EAD 090062-00-0404 Panels with a horizontal joint: Rockpanel A2, 8 mm finish Colours, Ply or ProtectPlus: classified category III according EAD 090062-00-0404 See Annex 5 Table 11 for the definition of use category | | |
| Mechanical resistance | See section 1, Table 1 | | |

[a] Partial factor for material property $\gamma_M = 4$ (tensile caused by wind load)[b] For the partial load factor $\gamma_F = 1.5$ shall be taken[c] Partial factor for material property $\gamma_M = 40$ [d] Partial factor for material property $\gamma_M = 1$ (shear caused by temporary load)

3.8 Aspects of durability

| | |
|-----------------------------------|---|
| Resistance to Hygrothermal cycles | Pass |
| Dimensional stability | See Table 6 |
| Immersion in water without UV | 21 days: Characteristic tensile strength for contact surfaces: rear of the board onto: ProtectPlus and Colours: $X_k = 8.10 \text{ N/mm}^1$ Aluminium: $X_k = 6.02 \text{ N/mm}^1$ |
| | 42 days: Characteristic tensile strength for contact surfaces: rear of the board onto: ProtectPlus and Colours: $X_k = 7.42 \text{ N/mm}^1$ Aluminium: $X_k = 5.82 \text{ N/mm}^1$ |
| Humidity and NaCl | Characteristic tensile strength for contact surfaces: rear of the board onto: Aluminium: $X_k = 8.03 \text{ N/mm}^1$ |
| Humidity and SO ₂ | Characteristic tensile strength for contact surfaces: rear of the board onto: Aluminium: $X_k = 8.68 \text{ N/mm}^1$ |
| Resistance to Xenon Arc exposure | Pass |

Reaction to fire**Table 4.** Euroclass classification of the Rockpanel A2, 8 mm board in different end-use constructions. The panels have been classified in accordance with EN 13501-1

| Fixing method | Finish | Set-up | Timber subframe | Metal subframe |
|---------------|---------------------------|---|------------------------------------|-------------------------------------|
| Mechanical | Colours, Ply | Non-ventilated | A2-s1,d0 closed joint | - |
| | Colours, Ply, ProtectPlus | Ventilated, 25 mm, with EPDM gasket on the battens [a] [c] | A2-s2,d0 open 8 mm joint | - |
| | Colours, ProtectPlus | Ventilated, 25 mm, with EPDM gasket on the battens and windboard in front of the insulation [a] [b] | A2-s1,d0 open 8 mm joint | - |
| | Colours, ProtectPlus | Ventilated, 28 mm, with vertical planks (≥ 100 mm) | - | A2-s1,d0 open 10 mm joint |
| Bonded | Colours, ProtectPlus | Ventilated, with Rockpanel A2, 8 mm strips on the battens [d] | A2-s1,d0 open 8 mm joint | - |

[a]: Width of the gasket 15 mm at both sides wider than the batten

[b]: The windboard is specified minimum A2-s1,d0 (according EN 13501-1) and K_{1,10} (according EN 13501-2) and placed between the subframe and the insulation.

[c]: A breathable membrane (minimum class B-s1,d0 according EN 13501-1) can be added between the subframe and the insulation.

[d]: Width of the strips 15 mm at both sides wider than the batten

Field of application

Further to the limitations described in section 1 of the ETA, the following field of application applies.

Euroclass classification

The classification mentioned in Table 4 is valid for the following end use conditions:

Mounting:

- Mechanically fixed to a timber or metal subframe
- Adhered to a timber subframe with intermediate Rockpanel strips mechanically fixed or adhered to an aluminium subframe.
- The panels are backed with min. 50 mm mineral wool insulation with density 30-70 kg/m³ according to EN 13162 with a cavity between the panels and the insulation. See section Insulation below.

Substrates:

- Concrete walls, masonry walls and timber framing.

Insulation:

- Ventilated constructions: The subframe is backed with min. 50 mm mineral wool insulation with density 30-70 kg/m³ according to EN 13162 with a cavity of minimal 28 mm for metal subframes and minimal 25 mm for timber subframes between the panels and the insulation.
- Non-ventilated constructions: The panels are backed with min. 40 mm mineral wool insulation with density 30-70 kg/m³ between the battens and min. 50 mm with density 30-70 kg/m³ behind the battens without an air gap.
- Ventilated construction and fixing method adhesive Bostik S970 Paneltack S: the panels are

backed with min. 50 mm mineral wool insulation with density 30-70 kg/m³ according to EN 13162 with a cavity of min. 35 mm between the panels and the insulation.

- Results are also valid for a greater thickness of mineral wool insulation with the same density and the same or better reaction to fire classification.
- The results also apply to panels without insulation, if the substrate chosen according to EN 13238 is made of a panel with Euroclass A1 or A2 (e.g. fibre-cement panels).

Subframe:

- Vertical softwood battens without fire retardant treatment, thickness minimum 25 mm.
- Test results are also valid for the same type of panel with a metal subframe.
- Test results are also valid for the same type of panel with vertical LVL battens, without fire retardant treatment, thickness minimum 27 mm.

Fixings:

- The results are also valid when using smaller mounting distances.
- Test results are also valid for the same type of panel fixed by rivets made of the same material of screws and vice versa.

Cavity:

- Unfilled or filled with insulation of mineral wool with a density of 30-70 kg/m³ according to EN 13162.
- The depth of the cavity is minimum 28 mm for a metal subframe, and minimum 25 mm for a timber subframe.
- Test results are also valid for other higher

thicknesses of air space between the back of the board and the insulation behind the subframe.

Joints:

- Horizontal joints can be open or closed with an aluminium profile. For metal subframes the vertical joints are without a gasket backing. For timber subframes the vertical battens are with an EPDM foam gasket (3 mm non-compressive thickness), flat EPDM gasket (0.75 mm) or Rockpanel strip backing as described in Table 4.
- The result from a test with an open horizontal joint is also valid for the same type of panel used in applications with horizontal joints closed by steel or aluminium profiles.
- Max joint width: 8 mm for a timber subframe and 10 mm for a metal subframe.

The classification is valid for the following product parameters:

Thickness:

- Nominal 8 mm

Density

- Nominal 1170 kg/m³

Aspects related to the performance of the product

All materials shall be manufactured by ROCKWOOL B.V. or by subcontractors under the responsibility of ROCKWOOL B.V.

The European Technical Assessment is issued for the product on the basis of agreed data/information, deposited with ETA-Danmark, which describes the product that has been assessed and judged. Changes to the product or production process, which could result in this deposited data/information being incorrect, should be notified to ETA-Danmark before the changes are introduced. ETA-Danmark will decide whether or not such changes affect the ETA and consequently the validity of the CE marking on the basis of the ETA and if so whether further assessment or alterations to the ETA, shall be necessary.

Installation details and application details for the man on site are given by ROCKWOOL B.V. / Rockpanel in the manufacturer's application guide technical dossier which forms part of the documentary material for this ETA. On every pallet label and/or on the protective film of every board the website is printed which guides the end user to the most actual information.

The boards are in general mounted with a joint width of at least 5 and up to 10 mm. See section Joints.

If the joints are to be sealed, only durable sealants should be used with a good adhesion on the edges of the boards and a good UV-stability. To prevent sticking to the subframe, a PE-film or tape can be used.

The boards for external cladding shall not be fixed over building or settlement joints. Where settlement joints are located in the building the same movements of the building and substructure shall be possible in the external cladding.

The panels should not be taken into account when designing a timber stud wall to resist racking forces.

The holes for the fixings are drilled into the panels not less than 15 mm (on timber subframe) and 20 mm (on metal subframe) from a vertical edge and 50 mm from a horizontal edge. The panels are fixed making sure that the screws are not over-tightened. For correct fixing, a riveting tool with rivet spacer must be used. For correct fixing of the self-drilling screw on aluminium a center sleeve should be used.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base


4.1 AVCP system

According to the decision 2003/640/EC of the European Commission as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) is 1, since there is a clearly identifiable stage in their production which results in an improvement of fire performance due to the limiting of organic material.

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking.


Issued in Copenhagen on 2026-03-11 by

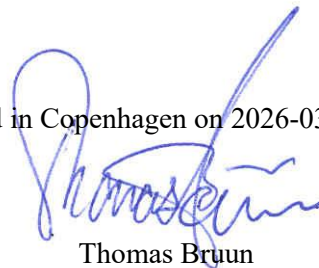

Thomas Bruun
Managing Director, ETA-Danmark


Annex 1
Pre-fabricated compressed mineral wool boards with organic or inorganic finish

Figure 1. Ventilated intended use on vertical metal subframe

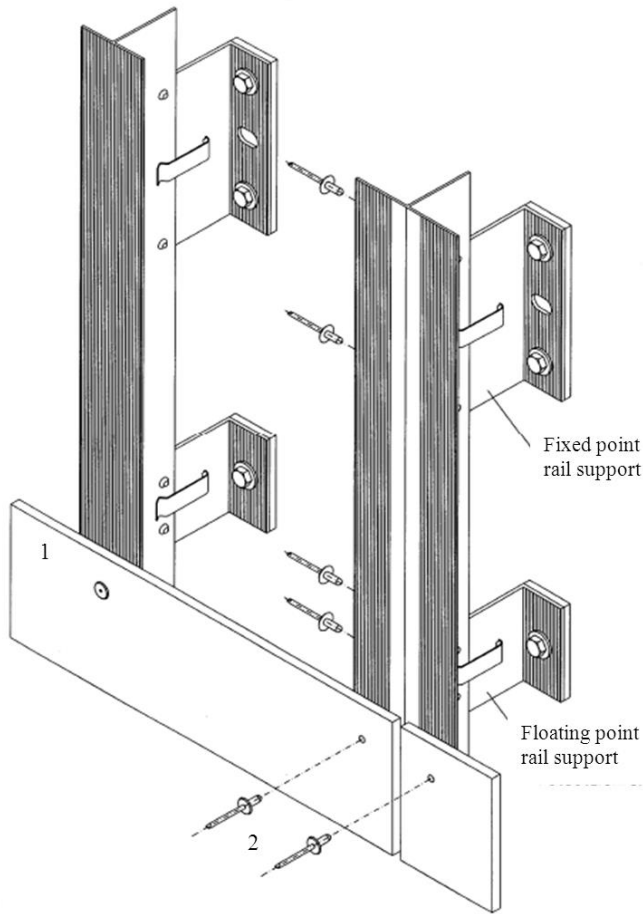

1. Compressed mineral wool board with organic or inorganic finish
2. Rivet fixing or self-drilling screw fixing


Figure 1a. Ventilated intended use on vertical timber battens

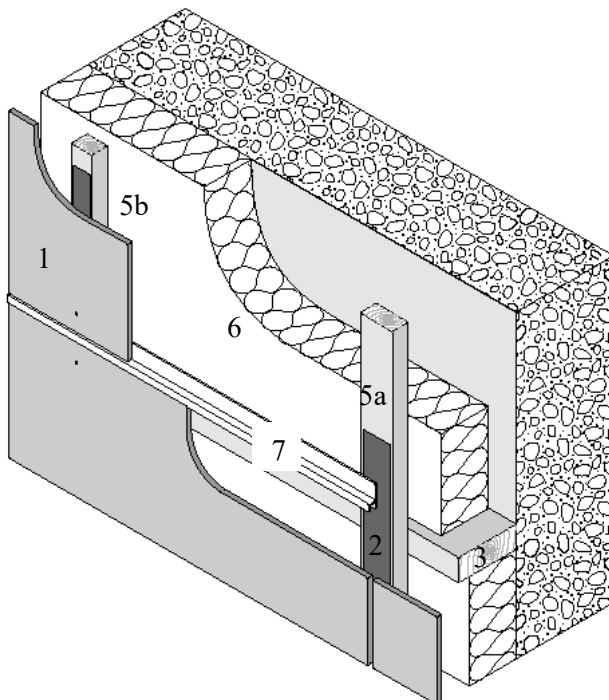

1. Compressed mineral wool board with organic or inorganic finish
2. EPDM gasket
3. Timber beam
4. Vapour barrier
5. Batten: a- joint and b – intermediate
6. Insulation
7. Rockpanel “A” – extruded aluminium chair-profile or equivalent.


Annex 1 - continued
 Pre-fabricated compressed mineral wool boards with organic or inorganic finish

Figure 1b. Non-ventilated intended use on vertical timber subframe

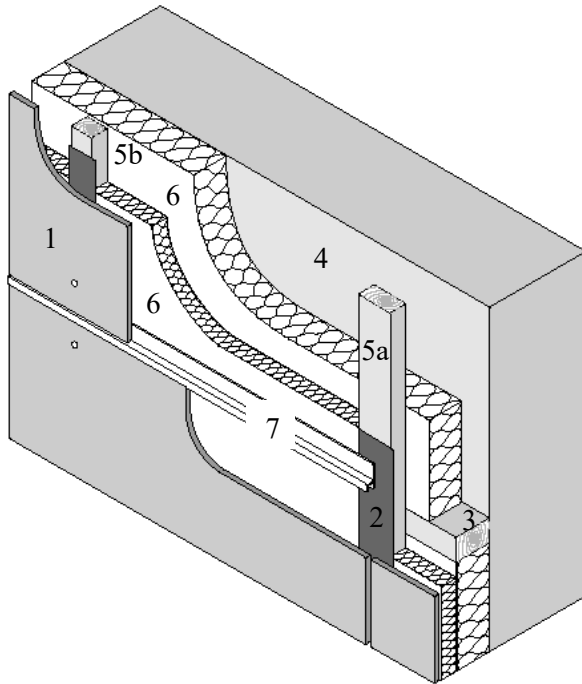

1. Compressed mineral wool board with organic or inorganic finish
2. For non-ventilated application (Figure 1b), the EPDM foam gasket is obliged
3. Timber beam
4. Vapour barrier
5. Batten:
a – joint
b – intermediate
6. Insulation
7. Rockpanel “A” – 8 mm extruded aluminium chair-profile or equivalent

Figure 2. Bonding with Bostik S970 Paneltack S. Only on ventilated intended use

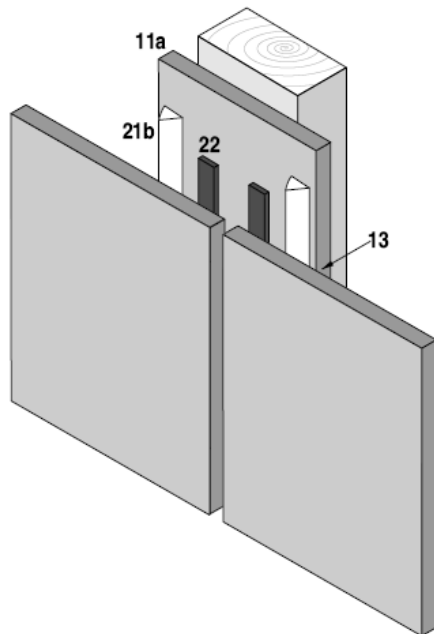


- 11a. Rockpanel A2, 8 mm strip, finish ‘Colours’ or ‘ProtectPlus’ (version without structure); strips mechanically fixed with Rockpanel nails or screws
13. Reverse of the board treated with ‘T922 Prep Q’.
- 21b. Triangular adhesive ridge with a height of 9 mm.
22. FoamTape self-adhesive on two sides 3*12 mm.


Annex 1 - continued
 Pre-fabricated compressed mineral wool boards with organic or inorganic finish

Figure 3. Bonding with Bostik S970 Paneltack S onto an aluminium subframe

3.1 Vertical joints between boards

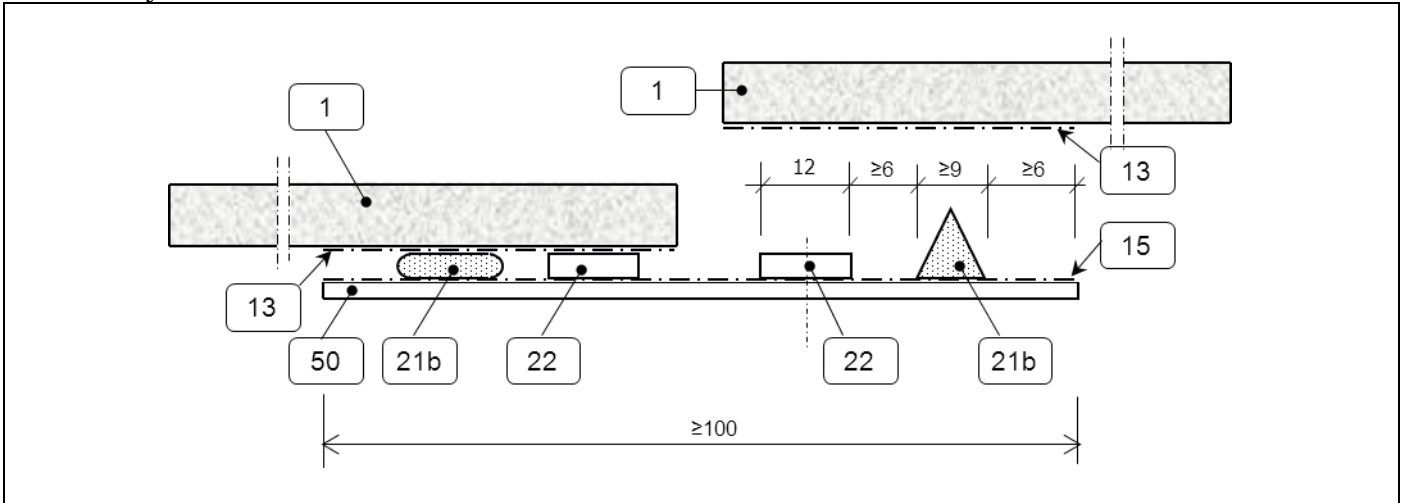

3.2 Bonding onto end profiles and onto intermediate profiles

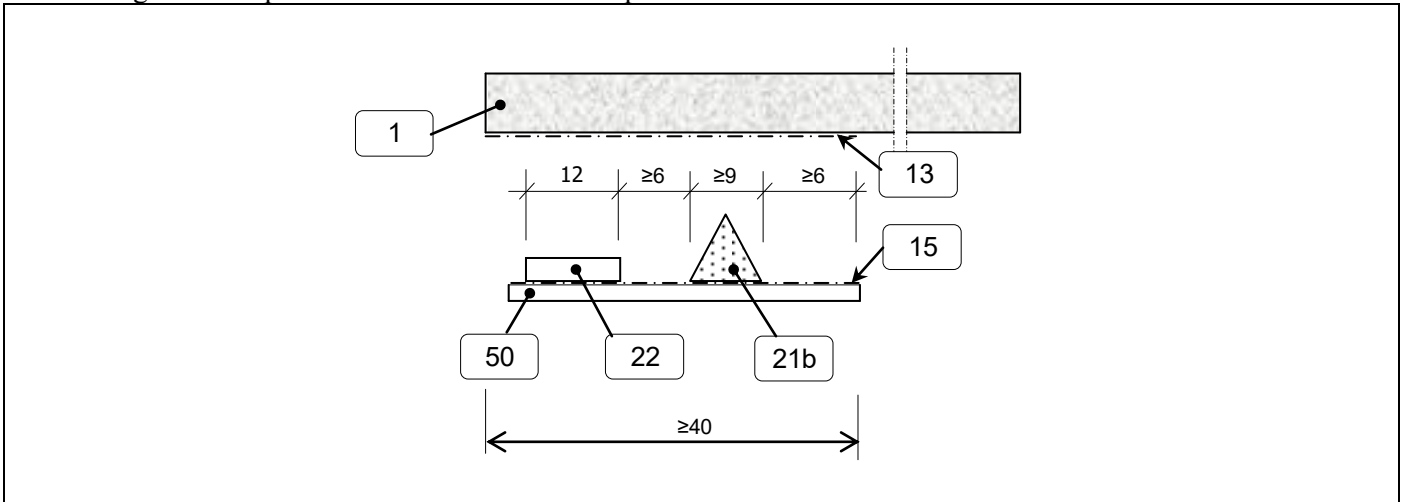


- | | |
|-----|--|
| 1 | Compressed mineral wool board with organic or inorganic finish |
| 13 | 'Bostik T922 Prep Q' applied with a roller in one layer |
| 15 | 'Bostik T920 Prep CS' one-step pretreatment |
| 21b | 'Bostik S970 Paneltack S' continuous triangular adhesive ridge of 9 mm |
| 22 | 'Foam Tape' self-adhesive on two sides 3*12 mm (with a release foil on one side) |
| 50 | Aluminium subframe |


Annex 1 - continued
 Pre-fabricated compressed mineral wool boards with organic or inorganic finish

Figure 4. Bonding with Bostik S970 Paneltack S onto a timber subframe with intermediate 8 mm Rockpanel strips

4.1 Vertical joints between boards

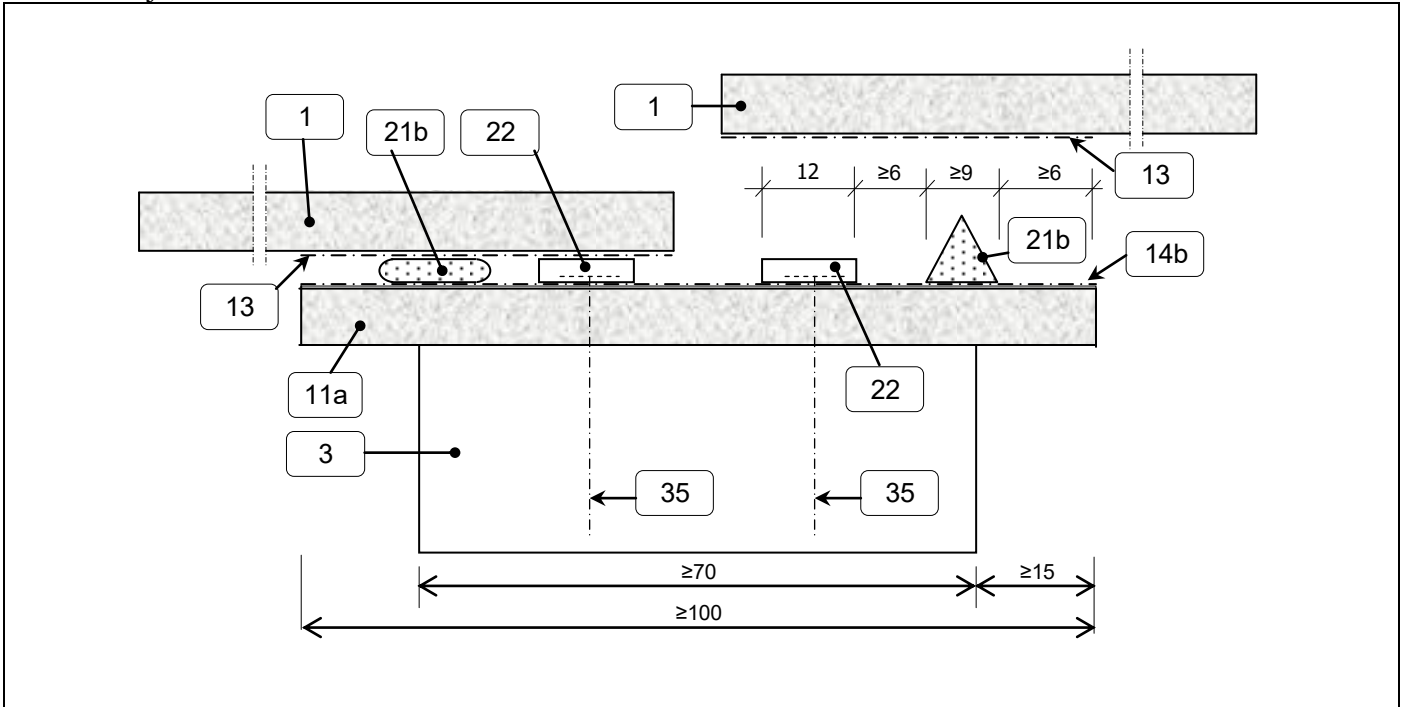


4.2 End batten and intermediate batten

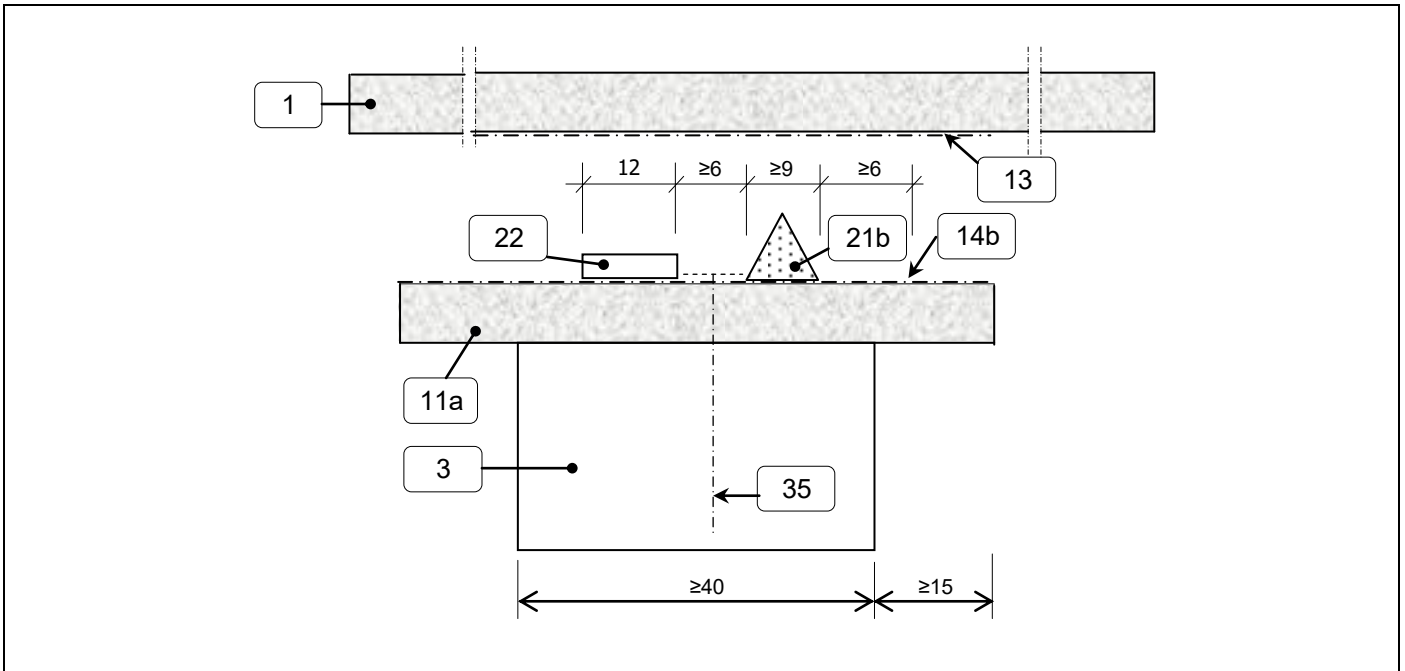

- | | |
|-----|---|
| 1 | Compressed mineral wool board with organic or inorganic finish |
| 3 | Subframe |
| 11a | Rockpanel strip with specified finish mechanically fixed in accordance with Annex 2 |
| 13 | 'Bostik T922 Prep Q' applied with a roller in one layer |
| 14b | 'Bostik T920 Prep CS' cleaner |
| 21b | 'Bostik S970 Paneltack S' continuous triangular adhesive ridge of 9 mm |
| 22 | 'Foam Tape' self-adhesive on two sides 3*12 mm (with a release foil on one side) |
| 35 | Mechanically fixed – screw or nail according to Annex 3 |

Annex 2
Mechanically fixing of Rockpanel strips for bonding Rockpanel boards
Minimum edge distances, fixing locations in the strip and maximum fixing distances

Figure 5. Fixing locations of Rockpanel strips for a timber subframe

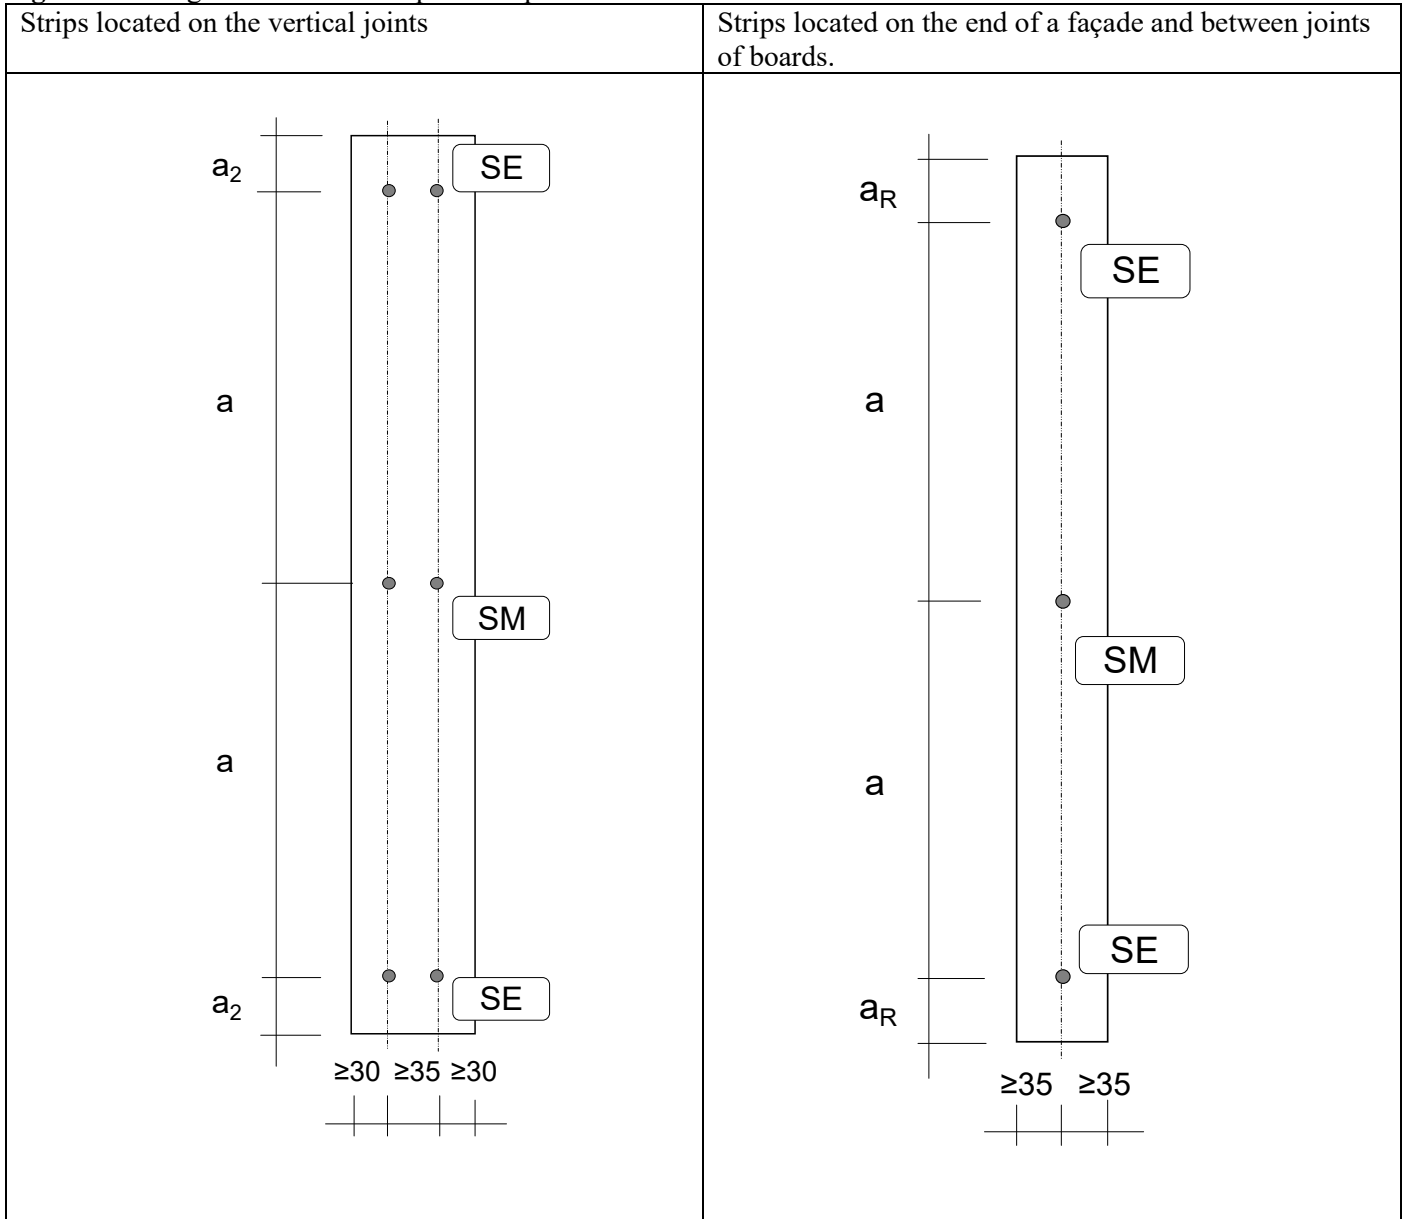

SM: fixing on the ‘middle’ location of a strip
 SE: fixing on the end locations of a strip

Hole diameters in accordance with Table 8
 Fixed points in the middle of the length of a strip

For bonded applications the Rockpanel strip (item 11a on Figure 2 in Annex 1) must be mechanically fixed in such a way that it can move tension free on the wooden battens.

Therefore, the Rockpanel strip is mounted with fixed points and moving points. The hole diameters for the fixing points are indicated in Table 8 (screw and nail fixing).


The characteristic loads which may be taken for the combination Rockpanel strips and fixings (screw and nail fixing), are given in Table 10-7, 10-8, 10-9 and 10-10 (position E and C).

| Fixing distances of 8 mm Rockpanel strips | | |
|---|-----------------|--------------|
| Fixing | Fixing distance | |
| | a_{max} | a_2 |
| Screw | 400 mm | ≥ 50 mm |
| Nail | 300 mm | ≥ 50 mm |

Annex 2 - continued

Mechanically fixing of Rockpanel strips for bonding Rockpanel boards
Minimum edge distances, fixing locations in the strip and maximum fixing distances

Figure 6. Example adhesive bonding onto Rockpanel strips

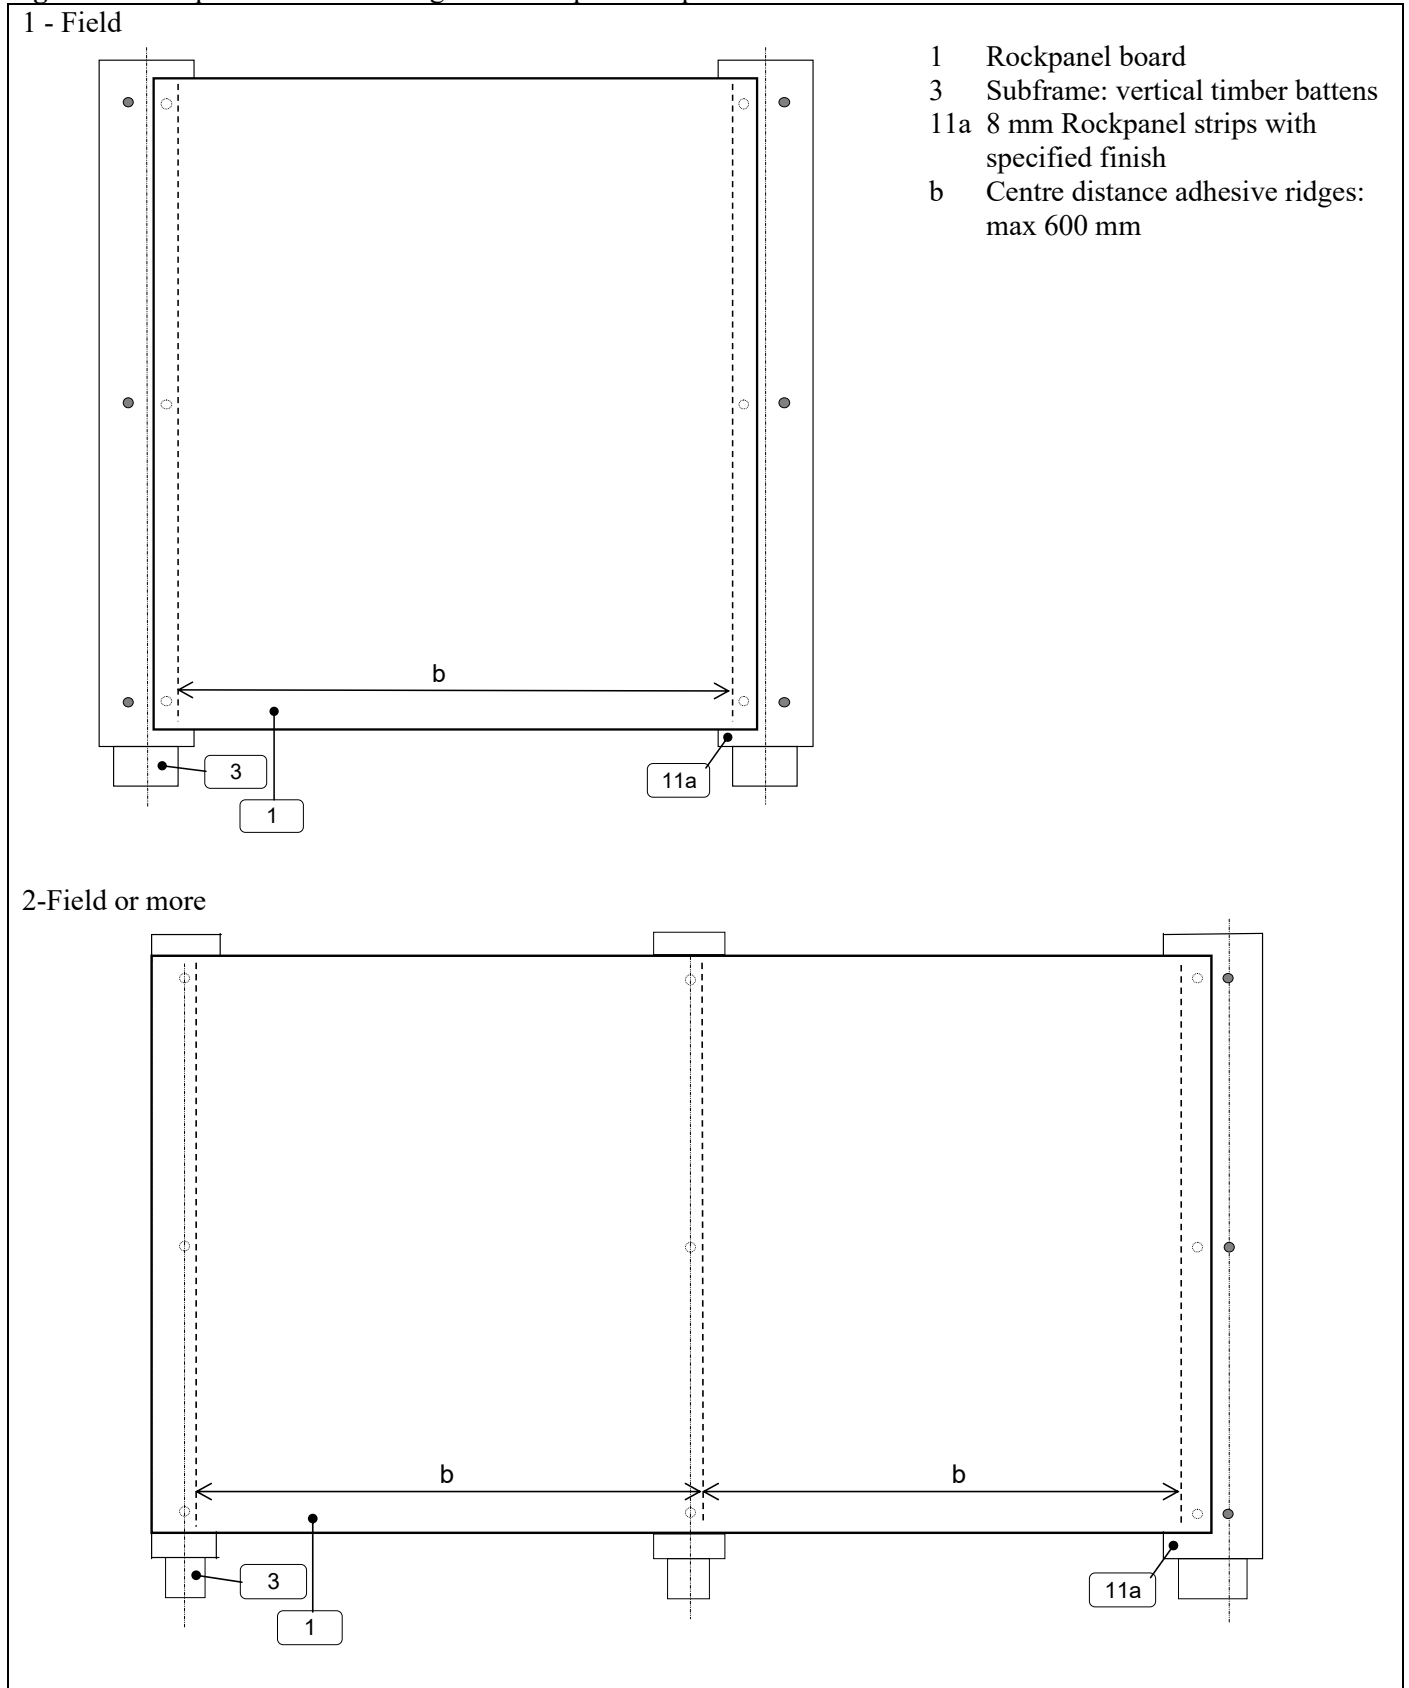

Annex 3
Fastener specification

A3.1 Fastener specification for metal sub-frames

Table 5. Rivet aluminium or stainless steel

| | | | | | |
|---------|--------------------------------------|--|--|--|--|
| | | SFS Aluminium | SFS Stainless steel A4 | MBE Aluminium | MBE Stainless steel |
| | Code | AP14-50180-S | SSO-D15-50180 | FN-AI5-5x18 K14 | FN-A4-5x18 K15 |
| | Body | Aluminium EN AW-5019 (AlMg5) in accordance with EN 755-2 | Stainless steel material number 1.4578 in accordance with EN 10088 | Aluminium EN AW-5019 (AlMg5) in accordance with EN 755-2 | Stainless steel material number 1.4578 in accordance with EN 10088 |
| | Mandrel | Stainless steel material number 1.4541 in accordance with EN 10088 | Stainless steel material number 1.4571 in accordance with EN 10088 | Stainless steel material number 1.4541 in accordance with EN 10088 | Stainless steel material number 1.4571 in accordance with EN 10088 |
| | Pull-out strength | $F_{u,5} = 1882 \text{ N}$ | $F_{u,5} = 1339$ | $F_{u,5} = 1882 \text{ N}$ | $F_{u,5} = 1339$ |
| | d^1 | 5 | 5 | 5 | 5 |
| | d^2 | 14 | 15 | 14 | 15 |
| | d^3 | 2.7 | 3.25 | 2.7 | 3.25 |
| | l | 18 | 18 | 18 | 18 |
| | k | 1.5 | 1.5 | 1.5 | 1.5 |
| Profile | Aluminium $t \geq 1.5 \text{ mm}$ | Steel $t \geq 1.0 \text{ mm}$ [a] [b] | Aluminium $t \geq 1.5 \text{ mm}$ | Steel $t \geq 1.0 \text{ mm}$ [a] [b] | |

[a]: The minimum thickness of the vertical steel profiles is 1.0 mm. The steel quality is S280GD +Z EN 10346 number 1.0250 (or equivalent for cold forming). For minimum coating thickness see [c]


[b]: The minimum thickness of the vertical steel profiles is 1.5 mm. The steel quality is EN 10025-2:2004 S235JR number 1.0038. For minimum coating thickness see [c]

[c]: The minimum coating thickness (Z or ZA) is determined by the corrosion rate (amount of corrosion loss in thickness per year) which depends on the specific outdoor atmospheric environment. The International Zinc association can be consulted for more information. The coating designation (classification which determines the coating mass) shall be agreed between the contractor and the building owner. Alternatively a hot dip galvanized coating according to EN ISO 1461 can be used.

Table 5-1. Self-drilling screw for aluminium; code: SDA4-D15-CS10/8-5.8x29-A4

Stainless steel A4 in accordance with EN ISO 3506

Length: 29 mm →
clamping length:
9.8 – 11.0 mm [a]

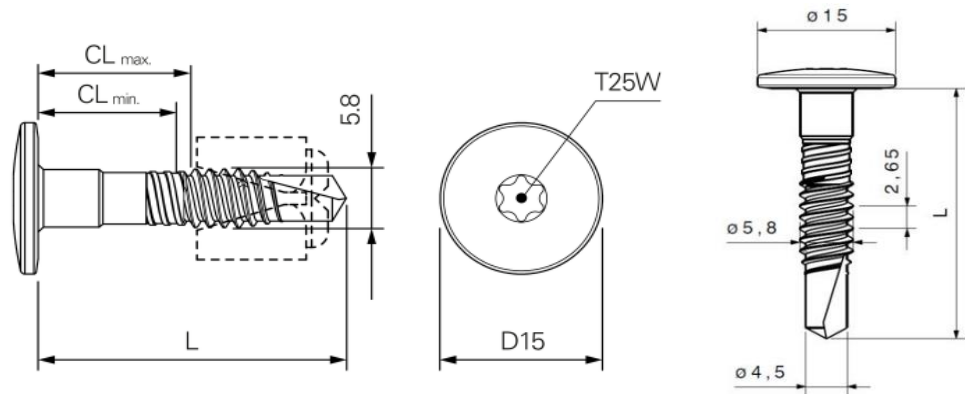


[a]: The minimum thickness of the aluminium profiles is 1.8 mm.

Table 5-2. Self-drilling screw for steel sub-constructs; code JT6-FR-3-5.5 x L


Stainless steel A4 in accordance with EN ISO 3506


Length:
25 mm →
clamping length 9 mm

35 mm →
clamping length 19 mm

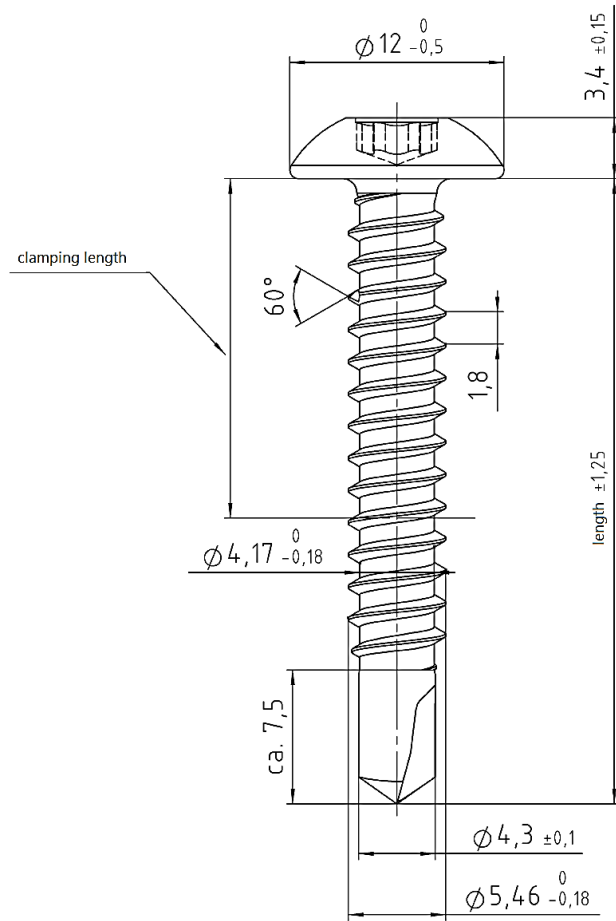

A3.2 Fastener specifications for wooden subframes
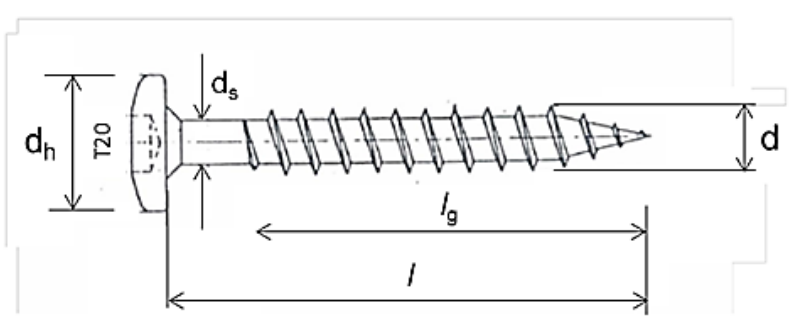
| | |
|--|--|
| <p>Table 5-3. Torx screws 4.5 x 35 mm</p> <p>Stainless steel in accordance with EN 10088 – Material number 1.4401 or 1.4578</p> <p>Definitions in accordance with EN 14592:2008+A1:2012</p> | |
| <p>$d = 4.3 - 4.6$ $d_s = 3.3 - 3.4$ $d_h = 9.6 - 10.4$ $l = 35.0 - 1.25$ $l_g = 26.25 - 28.5$</p> |  |
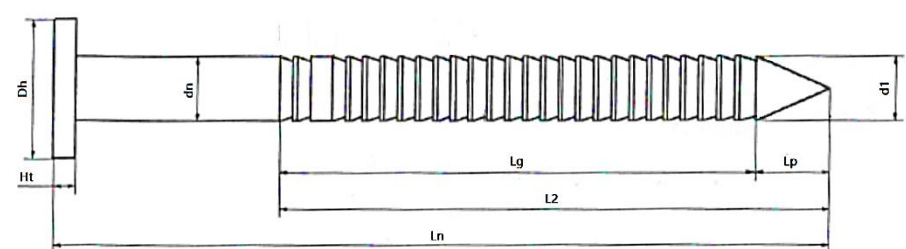
| | |
|--|---|
| <p>Table 5-4. Ring-shank nail, High Performance 2.7/3.1 x 35 mm</p> <p>Stainless steel in accordance with EN 10088 – Material number 1.4401 or 1.4578</p> <p>Definitions in accordance with EN 14592:2008+A1:2012</p> | |
| <p>$d_n = 2.7 \pm 0.1$ $d_1 = 3.1 \pm 0.1$ $L_n = 35 \pm 1.0$ $L_2 = 28 \pm 1.0$ $L_g = 25 \pm 1.0$ $L_p = 3 \pm 0.5$ $D_h = 6 \pm 0.2$ $H_t = 0.9 \pm 0.1$</p> |  |

**Annex 4
Performance**

Dimensional stability

Table 6. Deformation Rockpanel A2, 8 mm in accordance with EN 438-2

| Characteristic | Rockpanel A2, 8 mm | |
|---------------------------------|---------------------|--------------------|
| | Length of the board | Width of the board |
| Cumulative dimensional change % | 0.072 % | 0.072 % |

Fixing positions

Table 7. Fixing positions M / E / C used in this document



| | |
|---|---|
|  | <p>M: fixing in intermediate position E: edge fixing C: corner fixing See figure 2 for examples of possible installation methods</p> <p>Remark: Rivet fixing only with a riveting tool with rivet spacer</p> |
|---|---|

Figure 7. Examples of possible installation methods with the use of fixed points and slotted points

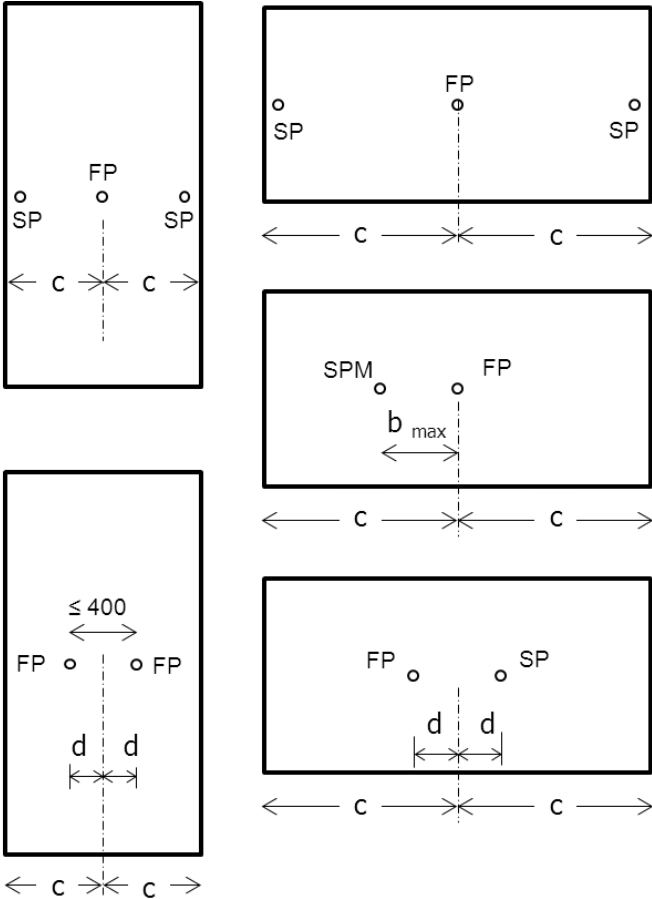

FP – fixed point
 SP – slotted point
 MP – moving point
 All the other fixing points are ‘moving points’
 b_{max}: see Table 9

FP:
 Fixed point may be realized by the use of a metal (aluminium or stainless steel) sleeve in a hole with the diameter of a moving point.

SP:
 Slotted points may be realized by the use of a metal (aluminium or stainless steel) side sleeve in a hole with the diameter of a moving point. Maximum distance between slide sleeve and fixed point amounts 600 mm.

SPM:
 Slotted point with the use of a slide sleeve (see also SP)

Annex 4 continued

Table 8. Hole diameters mm

| | Rivet | Self-drilling screw for aluminium [a] | Self-drilling screw for steel | High performance nail | Torx screw for timber | |
|--|---|---------------------------------------|--|-----------------------|-----------------------|-----------|
| | F – Fixed point | 5.1 | 5.8 | 4.3 | 2.5 | 3.2 |
| | S – Slotted holes | 5.1 x 8.0 | N.A. | 4.3 x 8.0 | 2.8 x 4.0 | 3.4 x 6.0 |
| | Moving points – all the other positions | 8.0 | 10.0 (with the use of a centering sleeve) | 8.0 | 3.8 | 6.0 |

[a]: The self-drilling screw for aluminium should always be fastened with 2 fixed points on the same horizontal level, max width 600 mm.

Table 9. Minimum edge distances and maximum distances between fastenings in mm

| | b_{max} | a_{max} | a_1 | a_2 |
|----------------------------------|-----------|--|-----------|-----------|
| Rivet | 600 | 600 | ≥ 20 | ≥ 50 |
| Self-drilling screw for metal | 600 | 600 | ≥ 20 | ≥ 50 |
| High Performance nail for timber | 600 | 400 | ≥ 15 | ≥ 50 |
| Torx screw on timber | 600 | 600 | ≥ 15 | ≥ 50 |
| Adhesive | 600 | Continuous triangular adhesive ridge of 9 mm | | |

Table 10. Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination rivet on an aluminium subframe and 8 mm Rockpanel A2 boards [a]

| | | | | |
|---|------------|------------|------------|------|
| Board thickness | 8 mm | | | (1) |
| Location of the fixing in the board | M-middle | E-edge | C-corner | (2) |
| Pull-through N | | | | (3) |
| Characteristic pull-through N | 962 | 647 | 444 | (4) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (5) |
| Design value X_d of the pull-through N | 481 | 324 | 222 | (6) |
| Wind suction | | | | (7) |
| Average wind load in N/m ² | 3025 | 3350 | 3507 | (8) |
| Average strength N | 1645 | 791 | 387 | (9) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (10) |
| Design value X_d of the pull-through N | 822 | 396 | 193 | (11) |
| Pull-out strength (lowest value of rivet/subframe combination) | | | | (12) |
| Pull-out $F_{u,5}$ N | 1300 | 1300 | 1300 | (13) |
| Material factor aluminium γ_M | 1.25 | 1.25 | 1.25 | (14) |
| Design value X_d of the pull-out N | 1040 | 1040 | 1040 | (15) |
| Design value of the axial load $X_d = X_k / \gamma_M$ for the combination rivet and 8 mm boards | 481 | 324 | 193 | (16) |
| Board span b | 600 | | | (17) |
| Fixing distance a | 600 | | | (18) |

[a]: For correct fixing, a riveting tool with rivet spacer must be used;

| Table 10-1. Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination self-drilling screw on an aluminium subframe and 8 mm Rockpanel A2 boards [a] | | | | |
|--|------------|------------|------------|------|
| Board thickness | 8 mm | | | (1) |
| Location of the fixing in the board | M-middle | E-edge | C-corner | (2) |
| Pull-through N | | | | (3) |
| Characteristic pull-through N | 986 | 593 | 457 | (4) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (5) |
| Design value X_d of the pull-through N | 493 | 297 | 229 | (6) |
| Wind suction | | | | (7) |
| Average wind load in N/m ² | 2732 | 3159 | 2748 | (8) |
| Average strength N | 1486 | 746 | 303 | (9) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (10) |
| Design value X_d of the pull-through N | 743 | 373 | 152 | (11) |
| Pull-out strength (lowest value of screw/subframe combination) | | | | (12) |
| Pull-out $F_{u,5}$ N | 1410 | 1410 | 1410 | (13) |
| Material factor aluminium γ_M | 1.25 | 1.25 | 1.25 | (14) |
| Design value X_d of the pull-out N | 1128 | 1128 | 1128 | (15) |
| Design value of the axial load $X_d = X_k / \gamma_M$ for the combination self-drilling screw and 8 mm boards | 493 | 297 | 152 | (16) |
| Board span b | 600 | | | (17) |
| Fixing distance a | 600 | | | (18) |

[a]: For correct fixing, the SFS center sleeves must be used.

| Table 10-2. Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination rivet on a steel subframe and 8 mm Rockpanel A2 boards [a] | | | | |
|---|------------|------------|------------|------|
| Board thickness | 8 mm | | | (1) |
| Location of the fixing in the board | M-middle | E-edge | C-corner | (2) |
| Pull-through N | | | | (3) |
| Characteristic pull-through N | 926 | 679 | 441 | (4) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (5) |
| Design value X_d of the pull-through N | 463 | 340 | 221 | (6) |
| Wind suction | | | | (7) |
| Average wind load in N/m ² | 2676 | 4916 | 6122 | (8) |
| Average strength N | 1455 | 1162 | 675 | (9) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (10) |
| Design value X_d of the pull-through N | 728 | 581 | 337 | (11) |
| Pull-out strength (lowest value of rivet/subframe combination) | | | | (12) |
| Pull-out $F_{u,5}$ N | 1300 | 1300 | 1300 | (13) |
| Material factor steel γ_M | 1.3 | 1.3 | 1.3 | (14) |
| Design value X_d of the pull-out N | 1000 | 1000 | 1000 | (15) |
| Design value of the axial load $X_d = X_k / \gamma_M$ for the combination rivet and 8 mm boards | 463 | 340 | 221 | (16) |
| Board span b | 600 | | | (17) |
| Fixing distance a | 600 | | | (18) |

[a]: For correct fixing, a riveting tool with rivet spacer must be used;

| Table 10-3. Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination self-drilling screw on a steel subframe and 8 mm Rockpanel A2 boards | | | | |
|---|------------|------------|------------|------|
| Board thickness | 8 mm | | | (1) |
| Location of the fixing in the board | M-middle | E-edge | C-corner | (2) |
| Pull-through N | | | | (3) |
| Characteristic pull-through N | 883 | 667 | 451 | (4) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (5) |
| Design value X_d of the pull-through N | 416 | 333 | 225 | (6) |
| Wind suction | | | | (7) |
| Average wind load in N/m ² | 2883 | 4140 | 4872 | (8) |
| Average strength N | 1568 | 978 | 537 | (9) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (10) |
| Design value X_d of the pull-through N | 784 | 489 | 269 | (11) |
| Pull-out strength (lowest value of screw/subframe combination) | | | | (12) |
| Pull-out $F_{u,5}$ N | 1100 | 1100 | 1100 | (13) |
| Material factor steel γ_M | 1.3 | 1.3 | 1.3 | (14) |
| Design value X_d of the pull-out N | 846 | 846 | 846 | (15) |
| Design value of the axial load $X_d = X_k / \gamma_M$ for the combination self-drilling screw and 8 mm boards | 416 | 333 | 225 | (16) |
| Board span b | 600 | | | (17) |
| Fixing distance a | 600 | | | (18) |

| Table 10-4. Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination solid timber, Nail – high performance and 8 mm Rockpanel A2 boards (with the use of gaskets), with $\alpha \geq 80^\circ$ [b] | | | | | | |
|---|------------|-------------------------------|----------------------|---|----------------------|------|
| Board thickness | 8 mm | | | (1) | | |
| Location of the fixing in the board | M-middle | E-edge | C-corner | (2) | | |
| Pull-through N | | | | (3) | | |
| Characteristic pull-through N | 765 | 541 | 396 | (4) | | |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (5) | | |
| Design value X_d of the pull-through N | 383 | 271 | 198 | (6) | | |
| Wind suction | | | | (7) | | |
| Average wind load in N/m ² | 2661 | 3777 | 4084 | (8) | | |
| Average strength N | 973 | 595 | 322 | (9) | | |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | 2.0 | (10) | | |
| Design value X_d of the pull-through N | 487 | 297 | 161 | (11) | | |
| Withdrawal capacity (gasket thickness 0.5 mm) | | | | (12) | | |
| Characteristic withdrawal capacity $F_{ax,k,Rk}$ [b] [c] | | | | (13) | | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | 403 | 403 | 403 | (14) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | 482 | 482 | 482 | (15) |
| Modification factor for k_{mod} | | | | k_{mod} [a] | (16) | |
| Axial withdrawal capacity $F_{ax,k,Rk} \cdot k_{mod}$ [a] [b] [c] | | | | (17) | | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $403 \cdot k_{mod}$ | $403 \cdot k_{mod}$ | $403 \cdot k_{mod}$ | (18) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $482 \cdot k_{mod}$ | $482 \cdot k_{mod}$ | $482 \cdot k_{mod}$ | (19) |
| Material factor (NA to) EN 1995-1-1+C1+A1/A2:2014 | | | | $\gamma_M = 1.30$ [withdrawal capacity] | (20) | |
| Design value X_d of the axial withdrawal capacity N | | | | (21) | | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $310 \cdot k_{mod}$ | $310 \cdot k_{mod}$ | $310 \cdot k_{mod}$ | (22) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $370 \cdot k_{mod}$ | $370 \cdot k_{mod}$ | $370 \cdot k_{mod}$ | (23) |
| Design value of the axial load $X_d = X_k / \gamma_M$ N | | | | minimum value of the rows: | (24) | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | (6) (11) (22) | (6) (11) (22) | (6) (11) (22) | (25) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | (6) (11) (23) | (6) (11) (23) | (6) (11) (23) | (26) |
| Board span b | 600 | | | (27) | | |
| Fixing distance a | 400 | | | (28) | | |

[a]: modification factor k_{mod} depends on the service class (humidity conditions) and the load-duration class according to the National Annex of EN 1995-1-1.[b]: α is the angle between the screw axis and the wood grain direction: $\alpha \geq 80^\circ$.

[c]: calculation in accordance with EN 1995-1-1+C1+A1/A2:2014 formula (8.23) and DIN EN 1995-1-1/NA:2013-08 Table NA.16

| Table 10-5. Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination solid timber, Torx Screw and 8 mm Rockpanel A2 boards (with the use of gaskets), with $\alpha \geq 30^\circ$ [c] | | | | | | |
|--|-----|-------------------------------|---|---------------------------------------|---------------------------------------|------|
| Board thickness | | | 8 mm | | | (1) |
| Location of the fixing in the board | | | M-middle | E-edge | C-corner | (2) |
| Pull-through N | | | | | | (3) |
| Characteristic pull-through N | | | 866 | 559 | 407 | (4) |
| Material factor Rockpanel γ_M | | | 2.0 | 2.0 | 2.0 | (5) |
| Design value X_d of the pull-through N | | | 433 | 280 | 203 | (6) |
| Wind suction | | | | | | (7) |
| Average wind load in N/m ² | | | 2438 | 2332 | 2645 | (8) |
| Average strength N | | | 1337 | 560 | 296 | (9) |
| Material factor Rockpanel γ_M | | | 2.0 | 2.0 | 2.0 | (10) |
| Design value X_d of the pull-through N | | | 669 | 280 | 148 | (11) |
| Withdrawal capacity (gasket thickness 0.5 mm) | | | | | | (12) |
| Characteristic withdrawal capacity $F_{ax,k,Rk}$ [b] [c] [d] | | | | | | (13) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | 858 | 858 | 858 | (14) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | 922 | 922 | 922 | (15) |
| Modification factor for k_{mod} | | | k_{mod} [a] | | | (16) |
| Axial withdrawal capacity $F_{ax,k,Rk} \cdot k_{mod}$ [a] [b] [c] [d] | | | | | | (17) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $858 \cdot k_{mod}$ | $858 \cdot k_{mod}$ | $858 \cdot k_{mod}$ | (18) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $922 \cdot k_{mod}$ | $922 \cdot k_{mod}$ | $922 \cdot k_{mod}$ | (19) |
| Material factor (NA to) EN 1995-1-1+C1+A1/A2:2014 | | | $\gamma_M = 1.30$ [withdrawal capacity] | | | (20) |
| Design value X_d of the axial withdrawal capacity N | | | | | | (21) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $660 \cdot k_{mod}$ | $660 \cdot k_{mod}$ | $660 \cdot k_{mod}$ | (22) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $709 \cdot k_{mod}$ | $709 \cdot k_{mod}$ | $709 \cdot k_{mod}$ | (23) |
| Design value of the axial load $X_d = X_k / \gamma_M$ N | | | minimum value of the rows: | | | (24) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | (6) (11) (22) | (6) (11) (22) | (6) (11) (22) | (25) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | (6) (11) (23) | (6) (11) (23) | (6) (11) (23) | (26) |
| Board span b | | | 600 | | | (27) |
| Fixing distance a | | | 600 | | | (28) |

[a]: modification factor k_{mod} depends on the service class (humidity conditions) and the load-duration class according to the National Annex of EN 1995-1-1.

[b]: with reduced thread diameter to fulfil the minimum l_{ef} demand ($d = l_{ef} / 6 = 24.75 / 6 = 4.12 \text{ mm}$).

[c]: α is the angle between the screw axis and the wood grain direction: $\alpha \geq 30^\circ$.


[d]: calculation in accordance with EN 1995-1-1+C1+A1/A2:2014 formula (8.38), (8.39) and (8.40)

| Table 10-6. Characteristic and design axial load $X_d = X_k / \gamma_M$ for A2 8 mm board with adhesive system The characteristic wind load must be multiplied with $\gamma_F = 1.5$ | | | | |
|--|-------------------------------|-------------------------|--|---|
| Adhesive [a] | | Rear board onto | Characteristic axial load X_k in N/mm ¹ | Design axial load $X_d = X_k / \gamma_M$ in N/mm ¹ |
| shear | -40°C, -20°C, +23°C and +80°C | Strips with ProtectPlus | 2.49 | 0.062 |
| | | Strips with Colours | 2.49 | 0.062 |
| | | Aluminium | 1.99 | 0.050 |
| tensile | -40°C, -20°C, +23°C and +80°C | Strips with ProtectPlus | 9.45 | 2.36 |
| | | Strips with Colours | 10.75 | 2.69 |
| | | Aluminium | 7.80 | 1.95 |
| Foam Tape | | Rear board onto | Characteristic X_k and Design X_d in N/mm ¹ | |
| shear | -40°C, -20°C, +23°C and +80°C | Strips with ProtectPlus | 1.17 | |
| | | Strips with Colours | 1.17 | |
| | | Aluminium | 0.75 | |
| tensile | -40°C, -20°C, +23°C and +80°C | Strips with ProtectPlus | 2.03 | |
| | | Strips with Colours | 2.14 | |
| | | Aluminium | 2.93 | |

[a] With a triangle of 9 by 9 mm, deformed to a rectangle with a thickness of 3 mm (thickness of foam tape), see Annex 1

Table 10-7. Rockpanel strips mechanically fixed for the use of a bonded application.

Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination **solid timber, Torx Screw** and 8 mm end strips or **joint strips**, with $\alpha \geq 30^\circ$ [c]

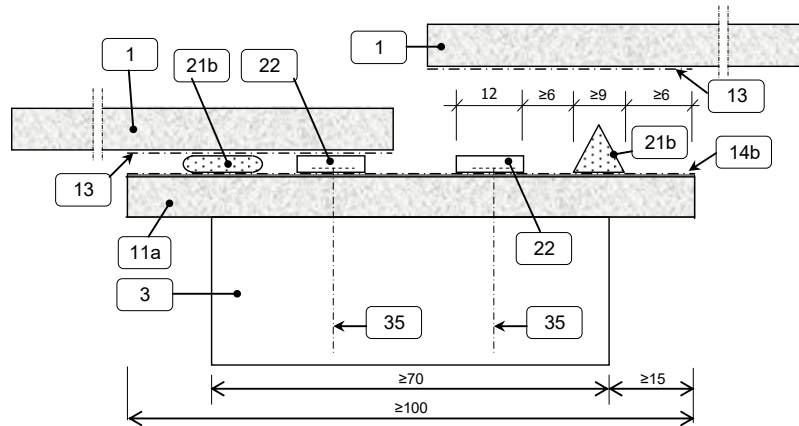

| | | | | | |
|--|--------------------------|-------------------------------|---|---------------------------------------|------|
| Strip thickness | 8 mm | | (1) | | |
| Location of the fixing in the strip | M-middle | Start and end SE | (2) | | |
| Design value X_d of the pull-through N in accordance with Annex 4 Table 10-5 row (6) | 280 Location E | 203 Location C | (3) | | |
| Wind suction | | | (4) | | |
| Average wind load in N/m ² | 6450 | 6450 | (5) | | |
| Average strength N | 2145 | 643 | (6) | | |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | (7) | | |
| Design value X_d of the pull-through N | 1072 | 321 | (8) | | |
| Withdrawal capacity in accordance with Table 10-5 Annex 4 | | | (9) | | |
| Characteristic withdrawal capacity $F_{ax,k,Rk}$ [b] [c] [d] | | | (10) | | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | 858 | 858 | (11) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | 922 | 922 | (12) |
| Modification factor for k_{mod} | | | k_{mod} [a] | (13) | |
| Axial withdrawal capacity $F_{ax,k,Rk} \cdot k_{mod}$ [a] [b] [c] [d] | | | | | (14) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $858 \cdot k_{mod}$ | $858 \cdot k_{mod}$ | (15) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $922 \cdot k_{mod}$ | $922 \cdot k_{mod}$ | (16) |
| Material factor (NA to) EN 1995-1-1+C1+A1/A2:2014 | | | $\gamma_M = 1.30$ [withdrawal capacity] | | (17) |
| Design value X_d of the axial withdrawal capacity N | | | | | (18) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $660 \cdot k_{mod}$ | $660 \cdot k_{mod}$ | (19) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $709 \cdot k_{mod}$ | $709 \cdot k_{mod}$ | (20) |
| Design value of the axial load $X_d = X_k / \gamma_M$ N | | | minimum value of the rows: | | (21) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | (3) (8) (19) | (3) (8) (19) | (22) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | (3) (8) (20) | (3) (8) (20) | (23) |
| Board span b | | | 600 | (24) | |
| Fixing distance a | | | 400 | (25) | |

[a]: modification factor k_{mod} depends on the service class (humidity conditions) and the load-duration class according to the National Annex of EN 1995-1-1.


[b]: with reduced thread diameter to fulfil the minimum l_{ef} demand ($d = l_{ef} / 6 = 24.75 / 6 = 4.12 \text{ mm}$).

[c]: α is the angle between the screw axis and the wood grain direction: $\alpha \geq 30^\circ$.

[d]: calculation in accordance with EN 1995-1-1+C1+A1/A2:2014 formula (8.38), (8.39) and (8.40)

Table 10-8. Rockpanel strips mechanically fixed for the use of a bonded application.

Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination **solid timber, Torx Screw** and 8 mm intermediate strips, with $\alpha \geq 30^\circ$ [c]

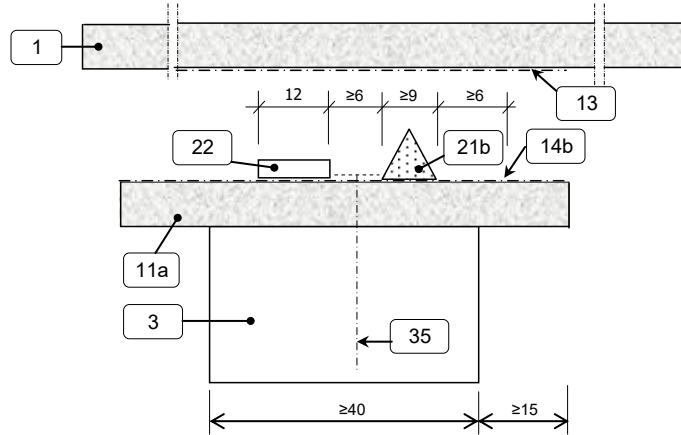

| | | | | | |
|--|--------------------------|-------------------------------|---|---------------------------------------|------|
| Strip thickness | 8 mm | | (1) | | |
| Location of the fixing in the strip | M-middle | Start and end SE | (2) | | |
| Design value X_d of the pull-through N in accordance with Annex 4 Table 10-5 row (6) | 280 Location E | 203 Location C | (3) | | |
| Wind suction | | | (4) | | |
| Average wind load in N/m ² | 5043 | 5043 | (5) | | |
| Average strength N | 2049 | 615 | (6) | | |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | (7) | | |
| Design value X_d of the pull-through N | 1024 | 307 | (8) | | |
| Withdrawal capacity in accordance with Table 10-5 Annex 4 | | | (9) | | |
| Characteristic withdrawal capacity $F_{ax,k,Rk}$ [b] [c] [d] | | | (10) | | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | 858 | 858 | (11) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | 922 | 922 | (12) |
| Modification factor for k_{mod} | | | k_{mod} [a] | (13) | |
| Axial withdrawal capacity $F_{ax,k,Rk} \cdot k_{mod}$ [a] [b] [c] [d] | | | | | (14) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $858 \cdot k_{mod}$ | $858 \cdot k_{mod}$ | (15) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $922 \cdot k_{mod}$ | $922 \cdot k_{mod}$ | (16) |
| Material factor (NA to) EN 1995-1-1+C1+A1/A2:2014 | | | $\gamma_M = 1.30$ [withdrawal capacity] | | (17) |
| Design value X_d of the axial withdrawal capacity N | | | | | (18) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $660 \cdot k_{mod}$ | $660 \cdot k_{mod}$ | (19) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $709 \cdot k_{mod}$ | $709 \cdot k_{mod}$ | (20) |
| Design value of the axial load $X_d = X_k / \gamma_M$ N | | | minimum value of the rows: | | (21) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | (3) (8) (19) | (3) (8) (19) | (22) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | (3) (8) (20) | (3) (8) (20) | (23) |
| Board span b | | | 600 | (24) | |
| Fixing distance a | | | 400 | (25) | |

[a]: modification factor k_{mod} depends on the service class (humidity conditions) and the load-duration class according to the National Annex of EN 1995-1-1.


[b]: with reduced thread diameter to fulfil the minimum l_{ef} demand ($d = l_{ef} / 6 = 24.75 / 6 = 4.12 \text{ mm}$).

[c]: α is the angle between the screw axis and the wood grain direction: $\alpha \geq 30^\circ$.

[d]: calculation in accordance with EN 1995-1-1+C1+A1/A2:2014 formula (8.38), (8.39) and (8.40)

Table 10-9. Rockpanel strips mechanically fixed for the use of a bonded application.

Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination **solid timber, HP nail 35 mm** and **8 mm end strips** or **joint strips**, with $\alpha \geq 80^\circ$ [b]

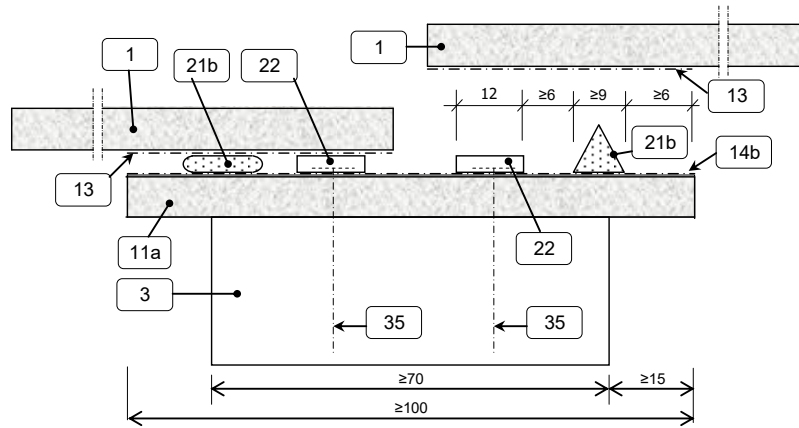

| | | | | |
|--|---|-------------------------------|---------------------------------------|------|
| Strip thickness | 8 mm | | (1) | |
| Location of the fixing in the strip | M-middle | Start and end SE | (2) | |
| Design value X_d of the pull-through N in accordance with Annex 4 Table 10-4 row (6) | 271 Location E | 198 Location C | (3) | |
| Wind suction | | | (4) | |
| Average wind load in N/m ² | 6243 | 6243 | (5) | |
| Average strength N | 1557 | 467 | (6) | |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | (7) | |
| Design value X_d of the pull-through N | 778 | 233 | (8) | |
| Withdrawal capacity in accordance with Table 10-4 Annex 4 | | | (9) | |
| Characteristic withdrawal capacity $F_{ax,k,Rk}$ [b] [c] | | | (10) | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | 403 | (11) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | 482 | (12) |
| Modification factor for k_{mod} | k_{mod} [a] | | (13) | |
| Axial withdrawal capacity $F_{ax,k,Rk} \cdot k_{mod}$ [a] [b] [c] | | | (14) | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $403 \cdot k_{mod}$ | (15) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $482 \cdot k_{mod}$ | (16) |
| Material factor (NA to) EN 1995-1-1+C1+A1/A2:2014 | $\gamma_M = 1.30$ [withdrawal capacity] | | (17) | |
| Design value X_d of the axial withdrawal capacity N | | | (18) | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $310 \cdot k_{mod}$ | (19) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $370 \cdot k_{mod}$ | (20) |
| Design value of the axial load $X_d = X_k / \gamma_M$ N | minimum value of the rows: | | (21) | |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | (3) (8) (19) | (22) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | (3) (8) (20) | (23) |
| Board span b | 600 | | (24) | |
| Fixing distance a | 300 | | (25) | |


[a]: modification factor k_{mod} depends on the service class (humidity conditions) and the load-duration class according to the National Annex of EN 1995-1-1.

[b]: α is the angle between the screw axis and the wood grain direction: $\alpha \geq 80^\circ$.

[c]: calculation in accordance with EN 1995-1-1+C1+A1/A2:2014 formula (8.23) and DIN EN 1995-1-1/NA:2013-08 Table NA.16

Table 10-10. Rockpanel strips mechanically fixed for the use of a bonded application.

Characteristic axial load X_k and design value of the axial load $X_d = X_k / \gamma_M$ for the combination **solid timber, HP nail 35 mm** and 8 mm **intermediate strips**, with $\alpha \geq 80^\circ$ [b]

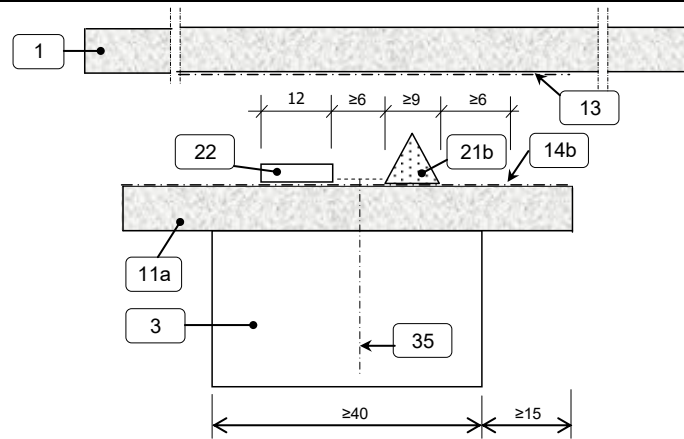

| | | | |
|--|---|-------------------------------|---------------------------------------|
| Strip thickness | 8 mm | | (1) |
| Location of the fixing in the strip | M-middle | Start and end SE | (2) |
| Design value X_d of the pull-through N in accordance with Annex 4 Table 10-4 row (6) | 271 Location E | 198 Location C | (3) |
| Wind suction | | | (4) |
| Average wind load in N/m ² | 3603 | 3603 | (5) |
| Average strength N | 1098 | 329 | (6) |
| Material factor Rockpanel γ_M | 2.0 | 2.0 | (7) |
| Design value X_d of the pull-through N | 549 | 164 | (8) |
| Withdrawal capacity in accordance with Table 10-4 Annex 4 | | | (9) |
| Characteristic withdrawal capacity $F_{ax,k,Rk}$ [b] [c] | | | (10) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | 403 |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | 482 |
| Modification factor for k_{mod} | k_{mod} [a] | | (13) |
| Axial withdrawal capacity $F_{ax,k,Rk} \cdot k_{mod}$ [a] [b] [c] | | | (14) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $403 \cdot k_{mod}$ |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $482 \cdot k_{mod}$ |
| Material factor (NA to) EN 1995-1-1+C1+A1/A2:2014 | $\gamma_M = 1.30$ [withdrawal capacity] | | (17) |
| Design value X_d of the axial withdrawal capacity N | | | (18) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | $310 \cdot k_{mod}$ |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | $370 \cdot k_{mod}$ |
| Design value of the axial load $X_d = X_k / \gamma_M$ N | minimum value of the rows: | | (21) |
| Strength class wood (EN 338) | C18 | $\rho_k = 320 \text{ kg/m}^3$ | (3) (8) (19) |
| | C24 | $\rho_k = 350 \text{ kg/m}^3$ | (3) (8) (20) |
| Board span b | 600 | | (24) |
| Fixing distance a | 300 | | (25) |

[a]: modification factor k_{mod} depends on the service class (humidity conditions) and the load-duration class according to the National Annex of EN 1995-1-1.

[b]: α is the angle between the screw axis and the wood grain direction: $\alpha \geq 80^\circ$.

[c]: calculation in accordance with EN 1995-1-1+C1+A1/A2:2014 formula (8.23) and DIN EN 1995-1-1/NA:2013-08 Table NA.16

Annex 5**Impact resistance**

| Table 11. Impact resistance: Definition of use categories | |
|--|--|
| Use category | Description |
| I | A zone readily accessible at ground level to the public and vulnerable to hard body impacts but not subjected to abnormally rough use. |
| II | A zone liable to impacts from thrown or kicked objects, but in public locations where the height of the kit will limit the size of the impact; or at lower levels where access to the building is primarily to those with some incentive to exercise care. |
| III | A zone not likely to be damaged by normal impacts caused by people or by thrown or kicked objects. |
| IV | A zone out of reach from ground level |

The hard body impact with steel ball represents the action from heavy, non-deformable objects, which accidentally hit the kit.